



The main source of heat is the LEGALETT System. If there is a supplementary heat supply, such as radiators or air heating, the temperature setting for the latter should be approximately 1-2°C (2-4°F) lower than the setting for LEGALETT.

Due to the high thermal mass of the slab, room temperature adjustments in the order of 1-2°C (2-4°F) may take a 1-2 day period to fully stabilize. Temporary reductions in temperature, such as in the event of a week's absence, should be avoided. Please consult your Owner's certificate for the Minimum Temperature Setpoint for your building.

It is required that the system be protected by a ground fault interrupt circuit breaker. A local interrupt (switch) should be installed for each heater and only shut off during servicing.

Note that the set temperature of a LEGALETT heated area can be 2-3°C (4-6°F) cooler than the typical set temperature of a conventionally heated room, while maintaining the same level of comfort and saving energy. In addition, since the temperature of the air at the ceiling is lower than it would be with a conventional system, heat loss through the ceiling is also reduced, saving additional energy.

## SETTING

LEGALETT thermostats should be operated in the HOLD mode and should be set between 17- 22°C (63-72°F) to achieve an optimal comfort level, depending on personal preference, for single tier energy rates.

For multi-tiered energy rate structures only, set the thermostat to 22°C (72°F) during the time periods of the lowest energy cost, and 17°C (63°F) during the time periods of the highest energy cost. Adjust as required for comfort, using the programmable mode. See thermostat instruction sheet for programming instructions.


The fan switch does not control the Legalett fan and has no effect. The flame indicates heating mode, NOT a call for heat.

## LOCATION - MOUNT DIRECTLY TO WALL (DOES NOT MOUNT TO ELECTRICAL BOX)

Each thermostat should be installed as follows:

1. In the area or zone served by the pipe loops that it is controlling.
2. 1500 mm (60") above the floor level.
3. So that the thermostat is not affected by direct sunlight or other sources of heat or cold.
4. So that the thermostat is not affected by any ventilation or cold air ducts.
5. Out of reach of a shower, tub or sink.


**ONE THERMOSTAT CONTROLLING ZONES IN 2 HEATERS**

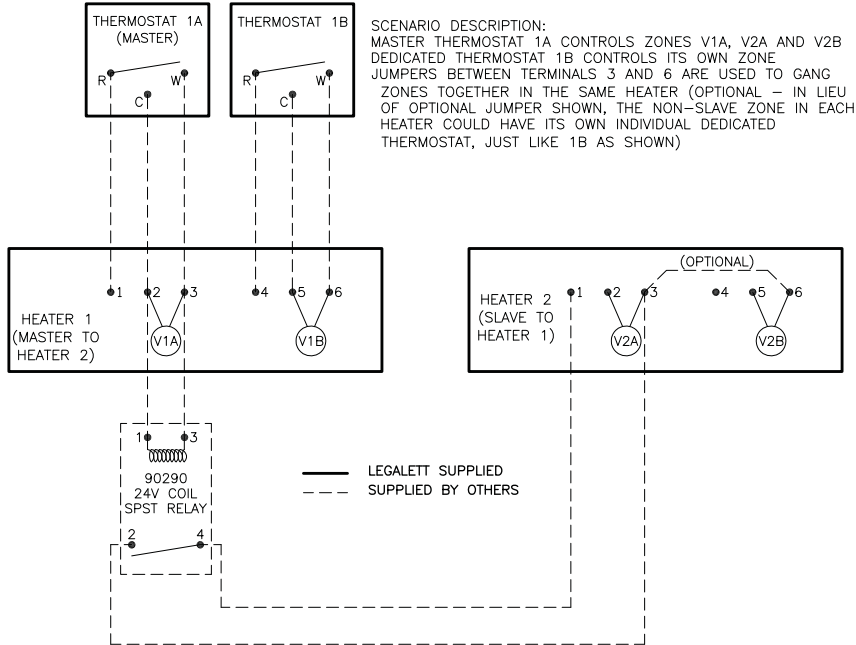

SCENARIO DESCRIPTION:  
MASTER THERMOSTAT 1A CONTROLS ZONES V1A, V2A AND V2B  
DEDICATED THERMOSTAT 1B CONTROLS ITS OWN ZONE  
JUMPERS BETWEEN TERMINALS 3 AND 6 ARE USED TO GANG ZONES TOGETHER IN THE SAME HEATER (OPTIONAL - IN LIEU OF OPTIONAL JUMPER SHOWN, THE NON-SLAVE ZONE IN EACH HEATER COULD HAVE ITS OWN INDIVIDUAL DEDICATED THERMOSTAT, JUST LIKE 1B AS SHOWN)

INTERLOCK REQUIRES 2 CONDUCTORS FOR MASTER HEATER/THERMOSTAT AND 2 CONDUCTORS FOR SLAVE HEATER, FROM MASTER TO SLAVE  
EXISTING INTERNAL HEATER WIRING NOT SHOWN FOR CLARITY  
SLAVE RELAY BY OTHERS - MARS 90290 OR GENERIC EQUIVALENT 24V AC COIL SPST FLANGE MOUNT RELAY  
SLAVE RELAY CAN CONNECT TO MASTER THERMOSTAT DIRECTLY TO TERMINALS C AND W  
\*\*A SINGLE SLAVE RELAY CAN CONTROL ONLY ONE SLAVE HEATER\*\* ONE RELAY IS REQUIRED FOR EACH SLAVE HEATER - SEE MULTIPLE HEATER DIAGRAM FOR MULTIPLE SLAVE HEATERS  
V = LEGALETT VALVE ACTUATOR OR LEGALETT ELECTRIC COIL RELAY

**ONE THERMOSTAT CONTROLLING ZONES IN 3+ HEATERS**

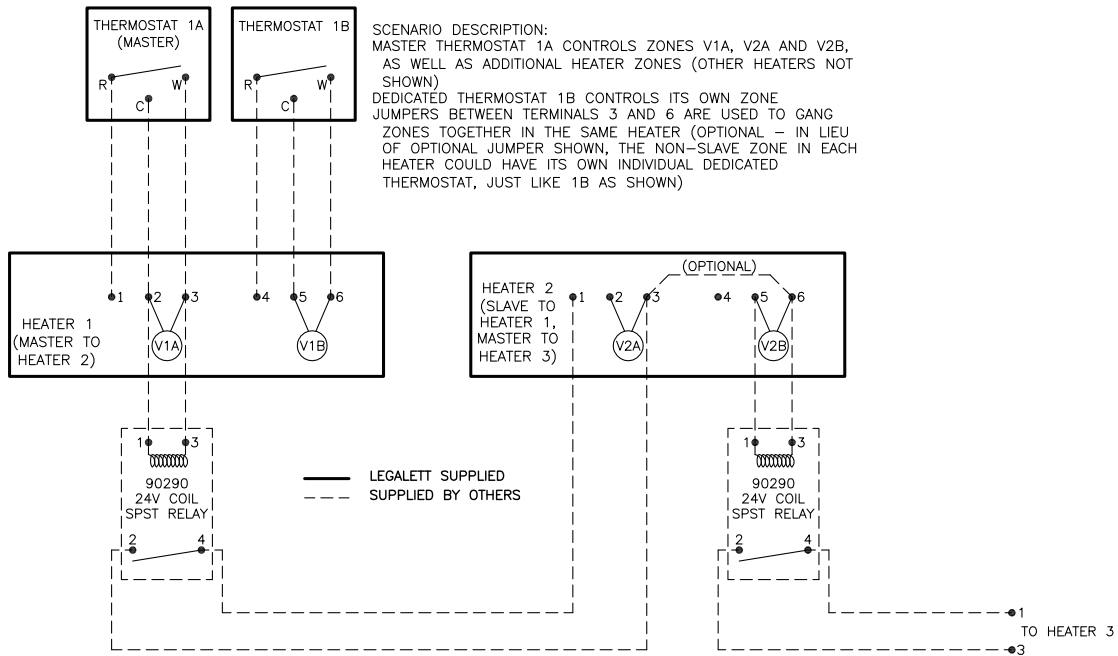

SCENARIO DESCRIPTION:  
MASTER THERMOSTAT 1A CONTROLS ZONES V1A, V2A AND V2B, AS WELL AS ADDITIONAL HEATER ZONES (OTHER HEATERS NOT SHOWN)  
DEDICATED THERMOSTAT 1B CONTROLS ITS OWN ZONE  
JUMPERS BETWEEN TERMINALS 3 AND 6 ARE USED TO GANG ZONES TOGETHER IN THE SAME HEATER (OPTIONAL - IN LIEU OF OPTIONAL JUMPER SHOWN, THE NON-SLAVE ZONE IN EACH HEATER COULD HAVE ITS OWN INDIVIDUAL DEDICATED THERMOSTAT, JUST LIKE 1B AS SHOWN)

INTERLOCK REQUIRES 2 CONDUCTORS FOR MASTER HEATER/THERMOSTAT AND 2 CONDUCTORS FOR SLAVE HEATER, FROM MASTER TO SLAVE. NOTE THAT ONE HEATER IN THE MIDDLE OF A CHAIN CAN BE BOTH MASTER AND SLAVE, AND THUS REQUIRE 4 CONDUCTORS IN TOTAL (AS SHOWN)  
EXISTING INTERNAL HEATER WIRING NOT SHOWN FOR CLARITY  
SLAVE RELAYS BY OTHERS - MARS 90290 OR GENERIC EQUIVALENT 24V AC COIL SPST FLANGE MOUNT RELAY  
SLAVE RELAY CAN CONNECT TO MASTER THERMOSTAT DIRECTLY TO TERMINALS C AND W  
\*\*A SINGLE SLAVE RELAY CAN CONTROL ONLY ONE SLAVE HEATER\*\* ONE RELAY IS REQUIRED FOR EACH SLAVE HEATER  
V = LEGALETT VALVE ACTUATOR OR LEGALETT ELECTRIC COIL RELAY